


Slimline Turnbuckles Installation Instructions

CSSLTRNBKL(BZ,SN)

This product is suitable for indoor dry locations only.
This product can be mounted onto the wall or ceiling.
This instructions shows a typical wall installation.



A Install the Slimline Turnbuckles Directly to the Electrical Box(es).

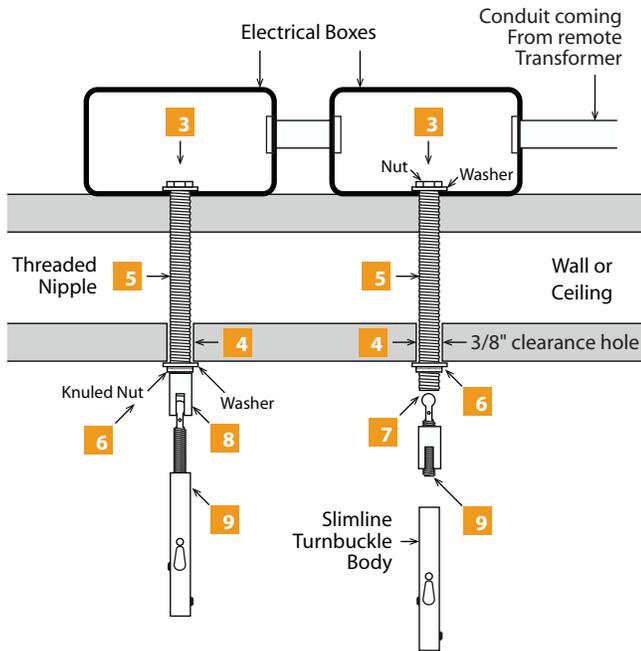

NOTE: Minimum Kable Lite cable separation must be 2".

NOTE: The Kable Lite power feed turnbuckle must be used on the wall or ceiling that is accessible from the other side, such as drop ceiling or wall between two rooms.

NOTE: If the Kable Lite cable separation is wider than an electrical box (not provided), then use two electrical boxes, one for each turnbuckle.

- 1** Determine the Cable Light cable separation.
- 2** Mark two points on the ceiling or wall for the Cable Light cable separation distance.
- 3** Drill the marked holes through (both side of the wall) with a 3/8" bit.
- 4** For power feed Slimline Turnbuckles, install the electrical box(es) on the back side of the wall or ceiling. Make sure that the electrical box(es) has 3/8" clearance hole(s) for the power feed nipple(s) to pass through.
- 5** Feed the threaded nipple of the Slimline Turnbuckle from the living space through the clearance holes into the electrical box. Leave 1/4" of the threaded nipple exposed on the living side for the post.
- 6** Secure the nipples with the washers and nuts.
- 7** Insert the ball screws into the posts.
- 8** Screw the posts onto the exposed portion of the threaded nipples.
- 9** Screw the Slimline Turnbuckles body onto the ball screws.
- 10** Install the remote transformer and the conduits between the remote transformer to the electrical box(es). Refer to the instructions provided with the remote transformer.